

RUN @ SW CORNER

10

C

12" Burck

14'-2"

4'-2"

14'-4"

10"

6" Burck  
Flu Sola

12" Burck  
Flu Sola


W/12x50

5" Burck  
FIT INTO ENTRANCE

8" Burck

NOTE: GROUT SHALL CONFORM TO ASTM C476

"MORTAR AND GROUT FOR REINFORCED MASONRY"  
ON ALL DETAILS.

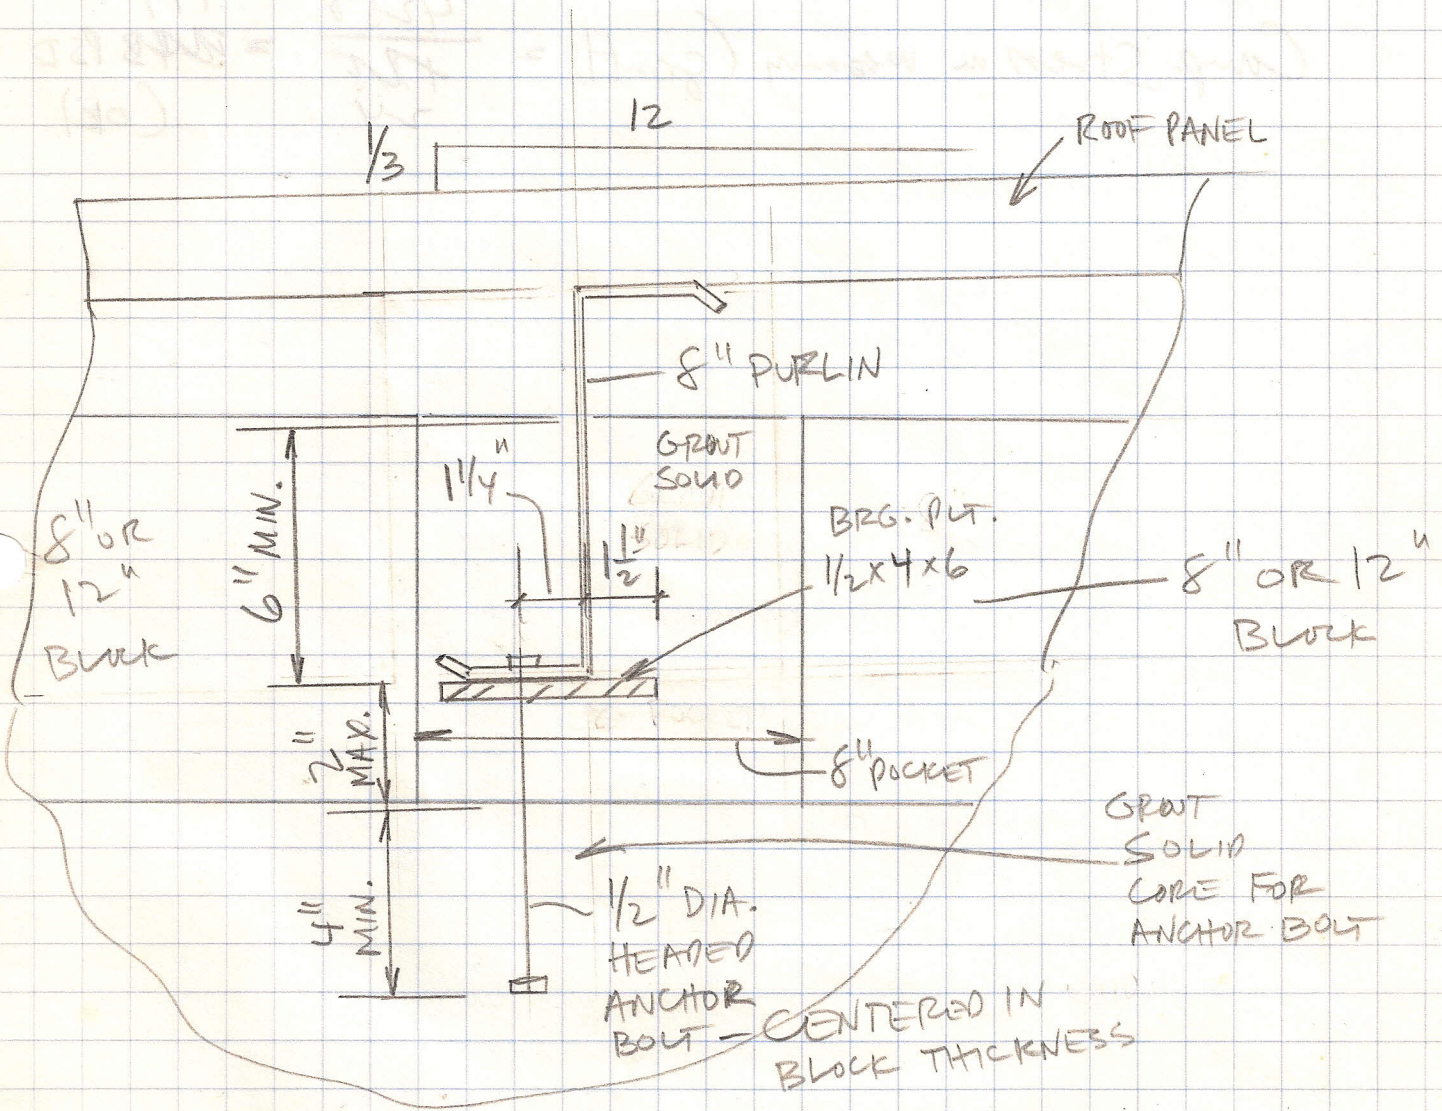


PURLIN ANCHORAGE AT TOP OF WALLS

— APPLIES TO WALLS AT FRAMES 1, 5 & 7 (NOT 10)

NOTE: DETAIL SIMILAR FOR PURLIN  
GOING THROUGH WALL.  
POCKET SHALL BE FILLED ALL  
AROUND PURLIN.



INTERMODAL FACILITY  
COLUMBUS, OHIO

JFM

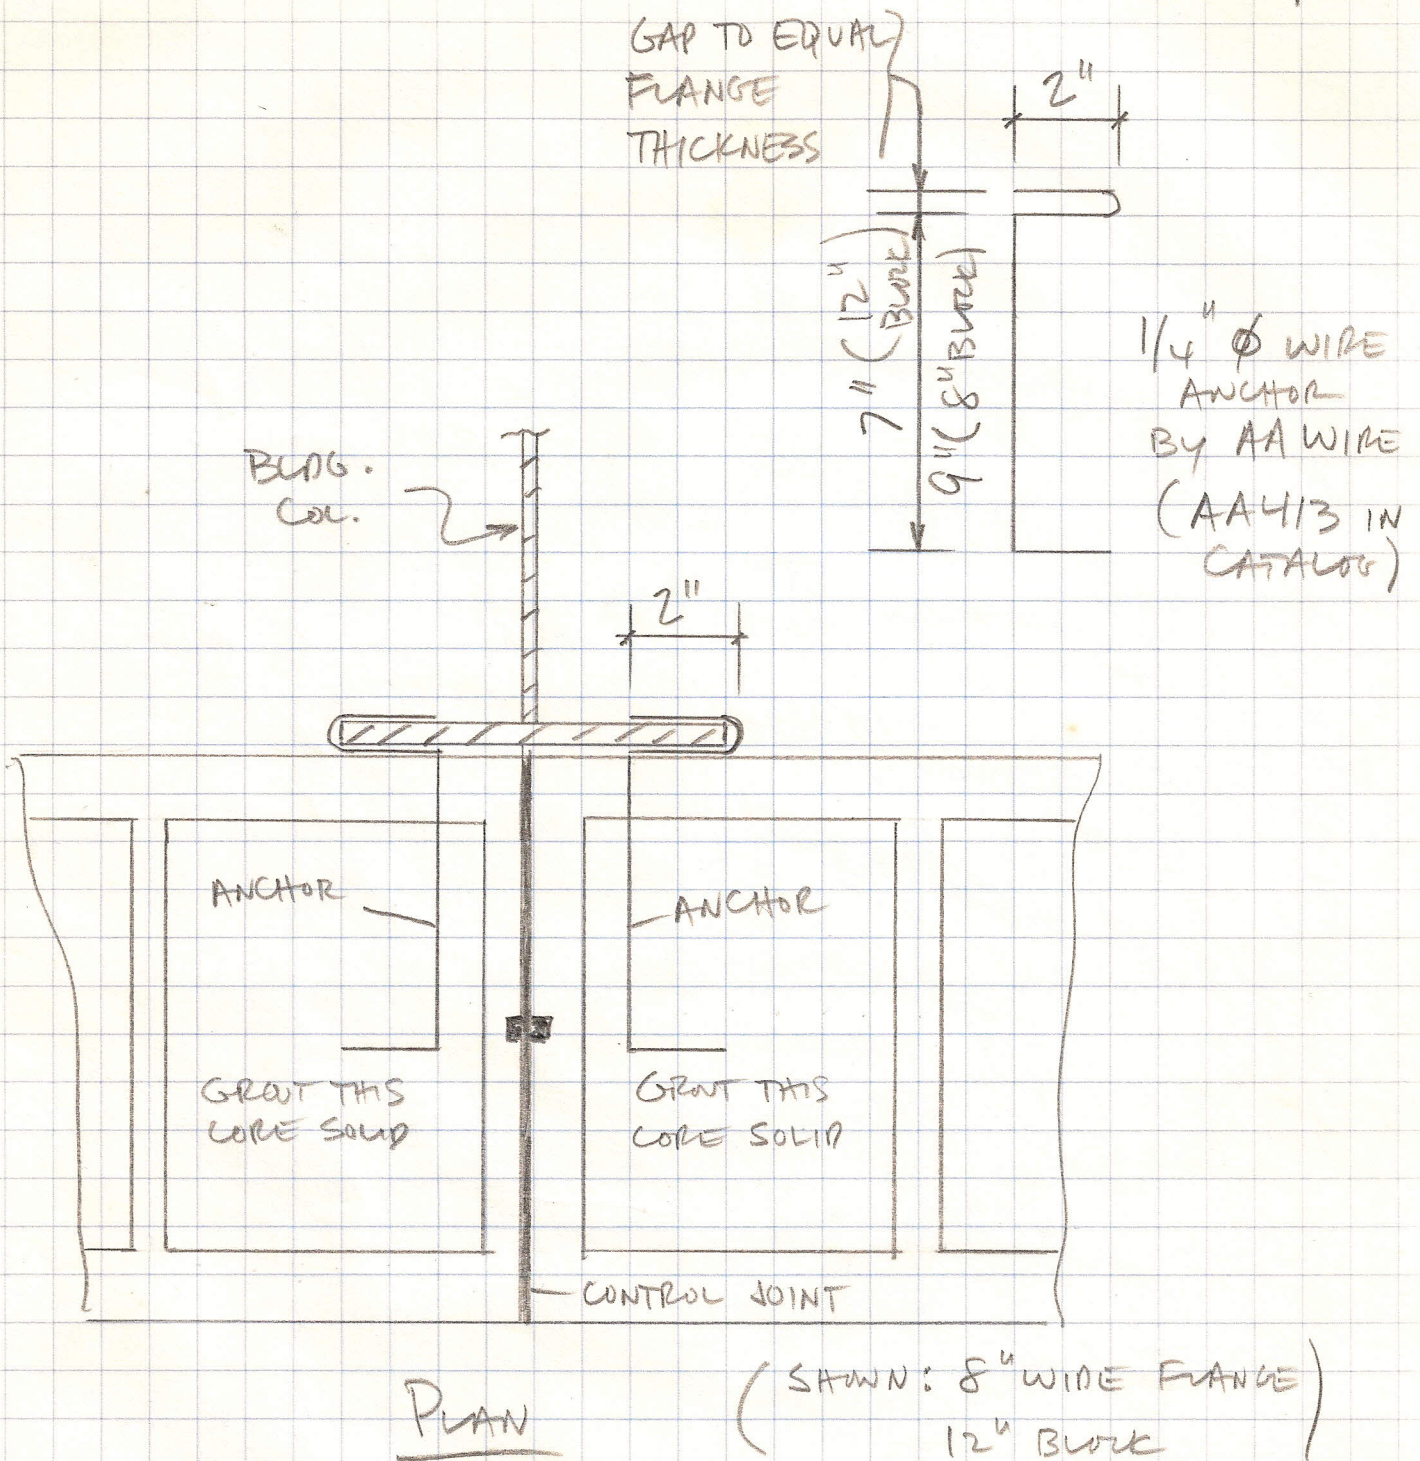

DETAIL OF WALL ANCHOR CONNECTION TO COLUMN FLANGES

CHANGED FROM 3 3/8  
 TO ANCHOR UPWARD  
 MOVEMENT DUE  
 TO SUCTION  
 4-30-86 JFM

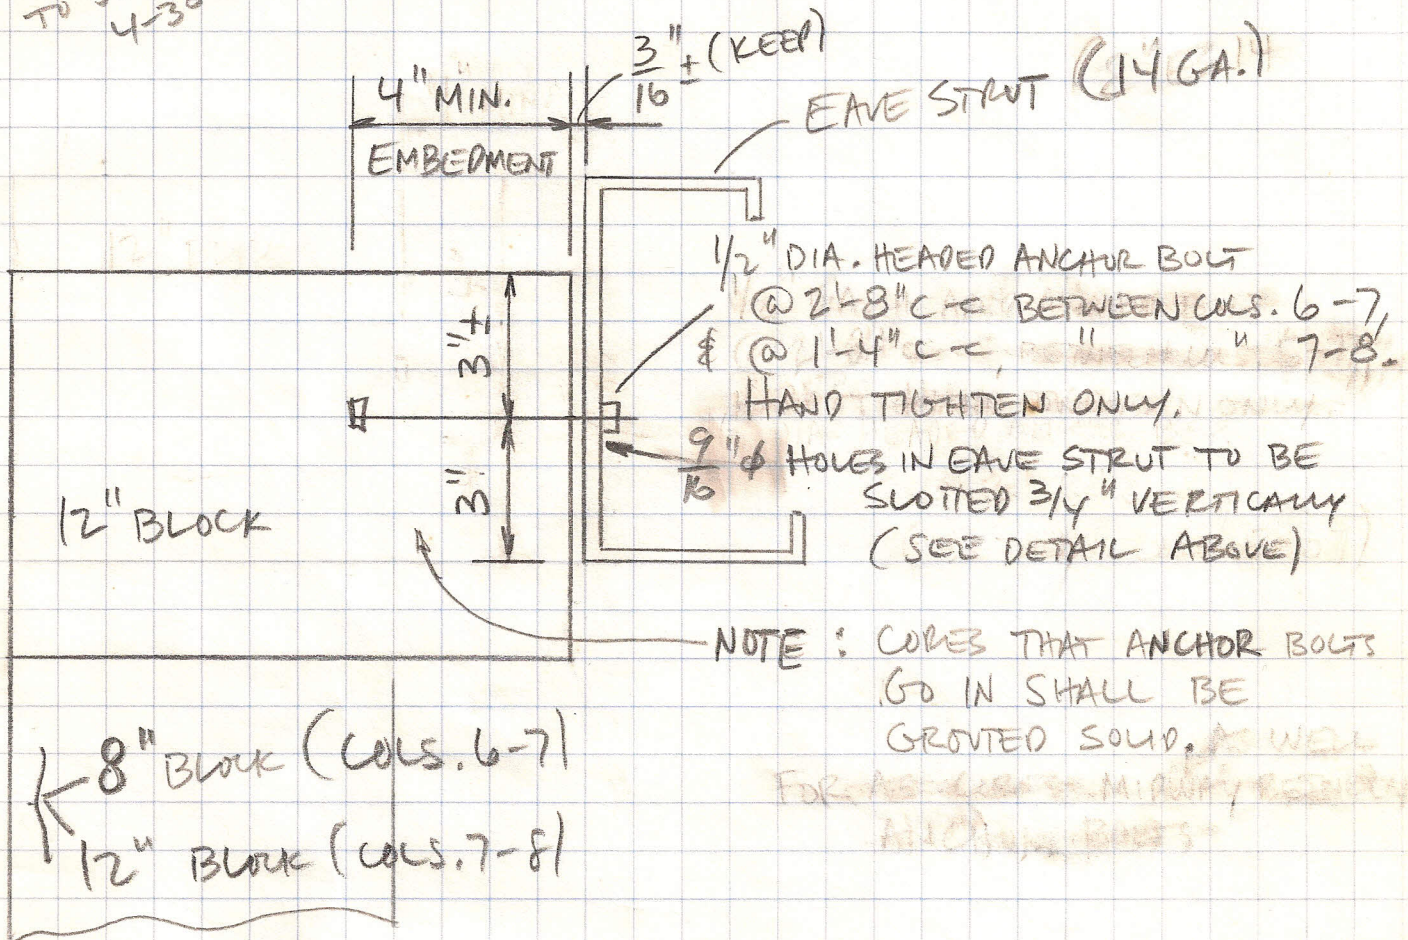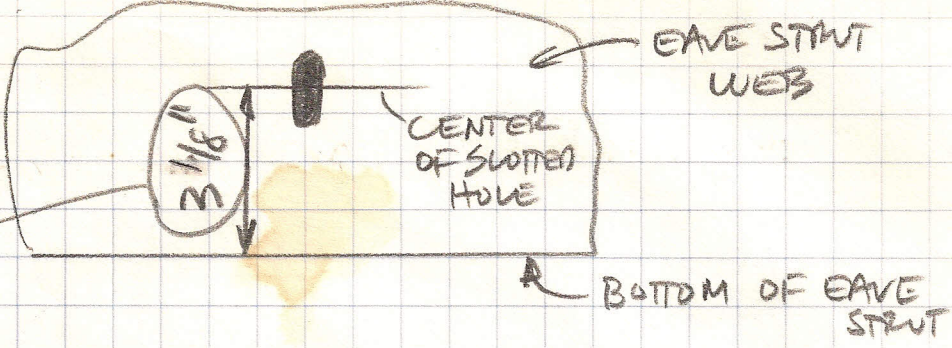

EAVE STRUT CONNECTION TO WALLS  
 FROM COLUMNS 6 TO 8

INTERNODAL FACILITY  
 COLUMBUS, OHIO

JFM  
 SH.5